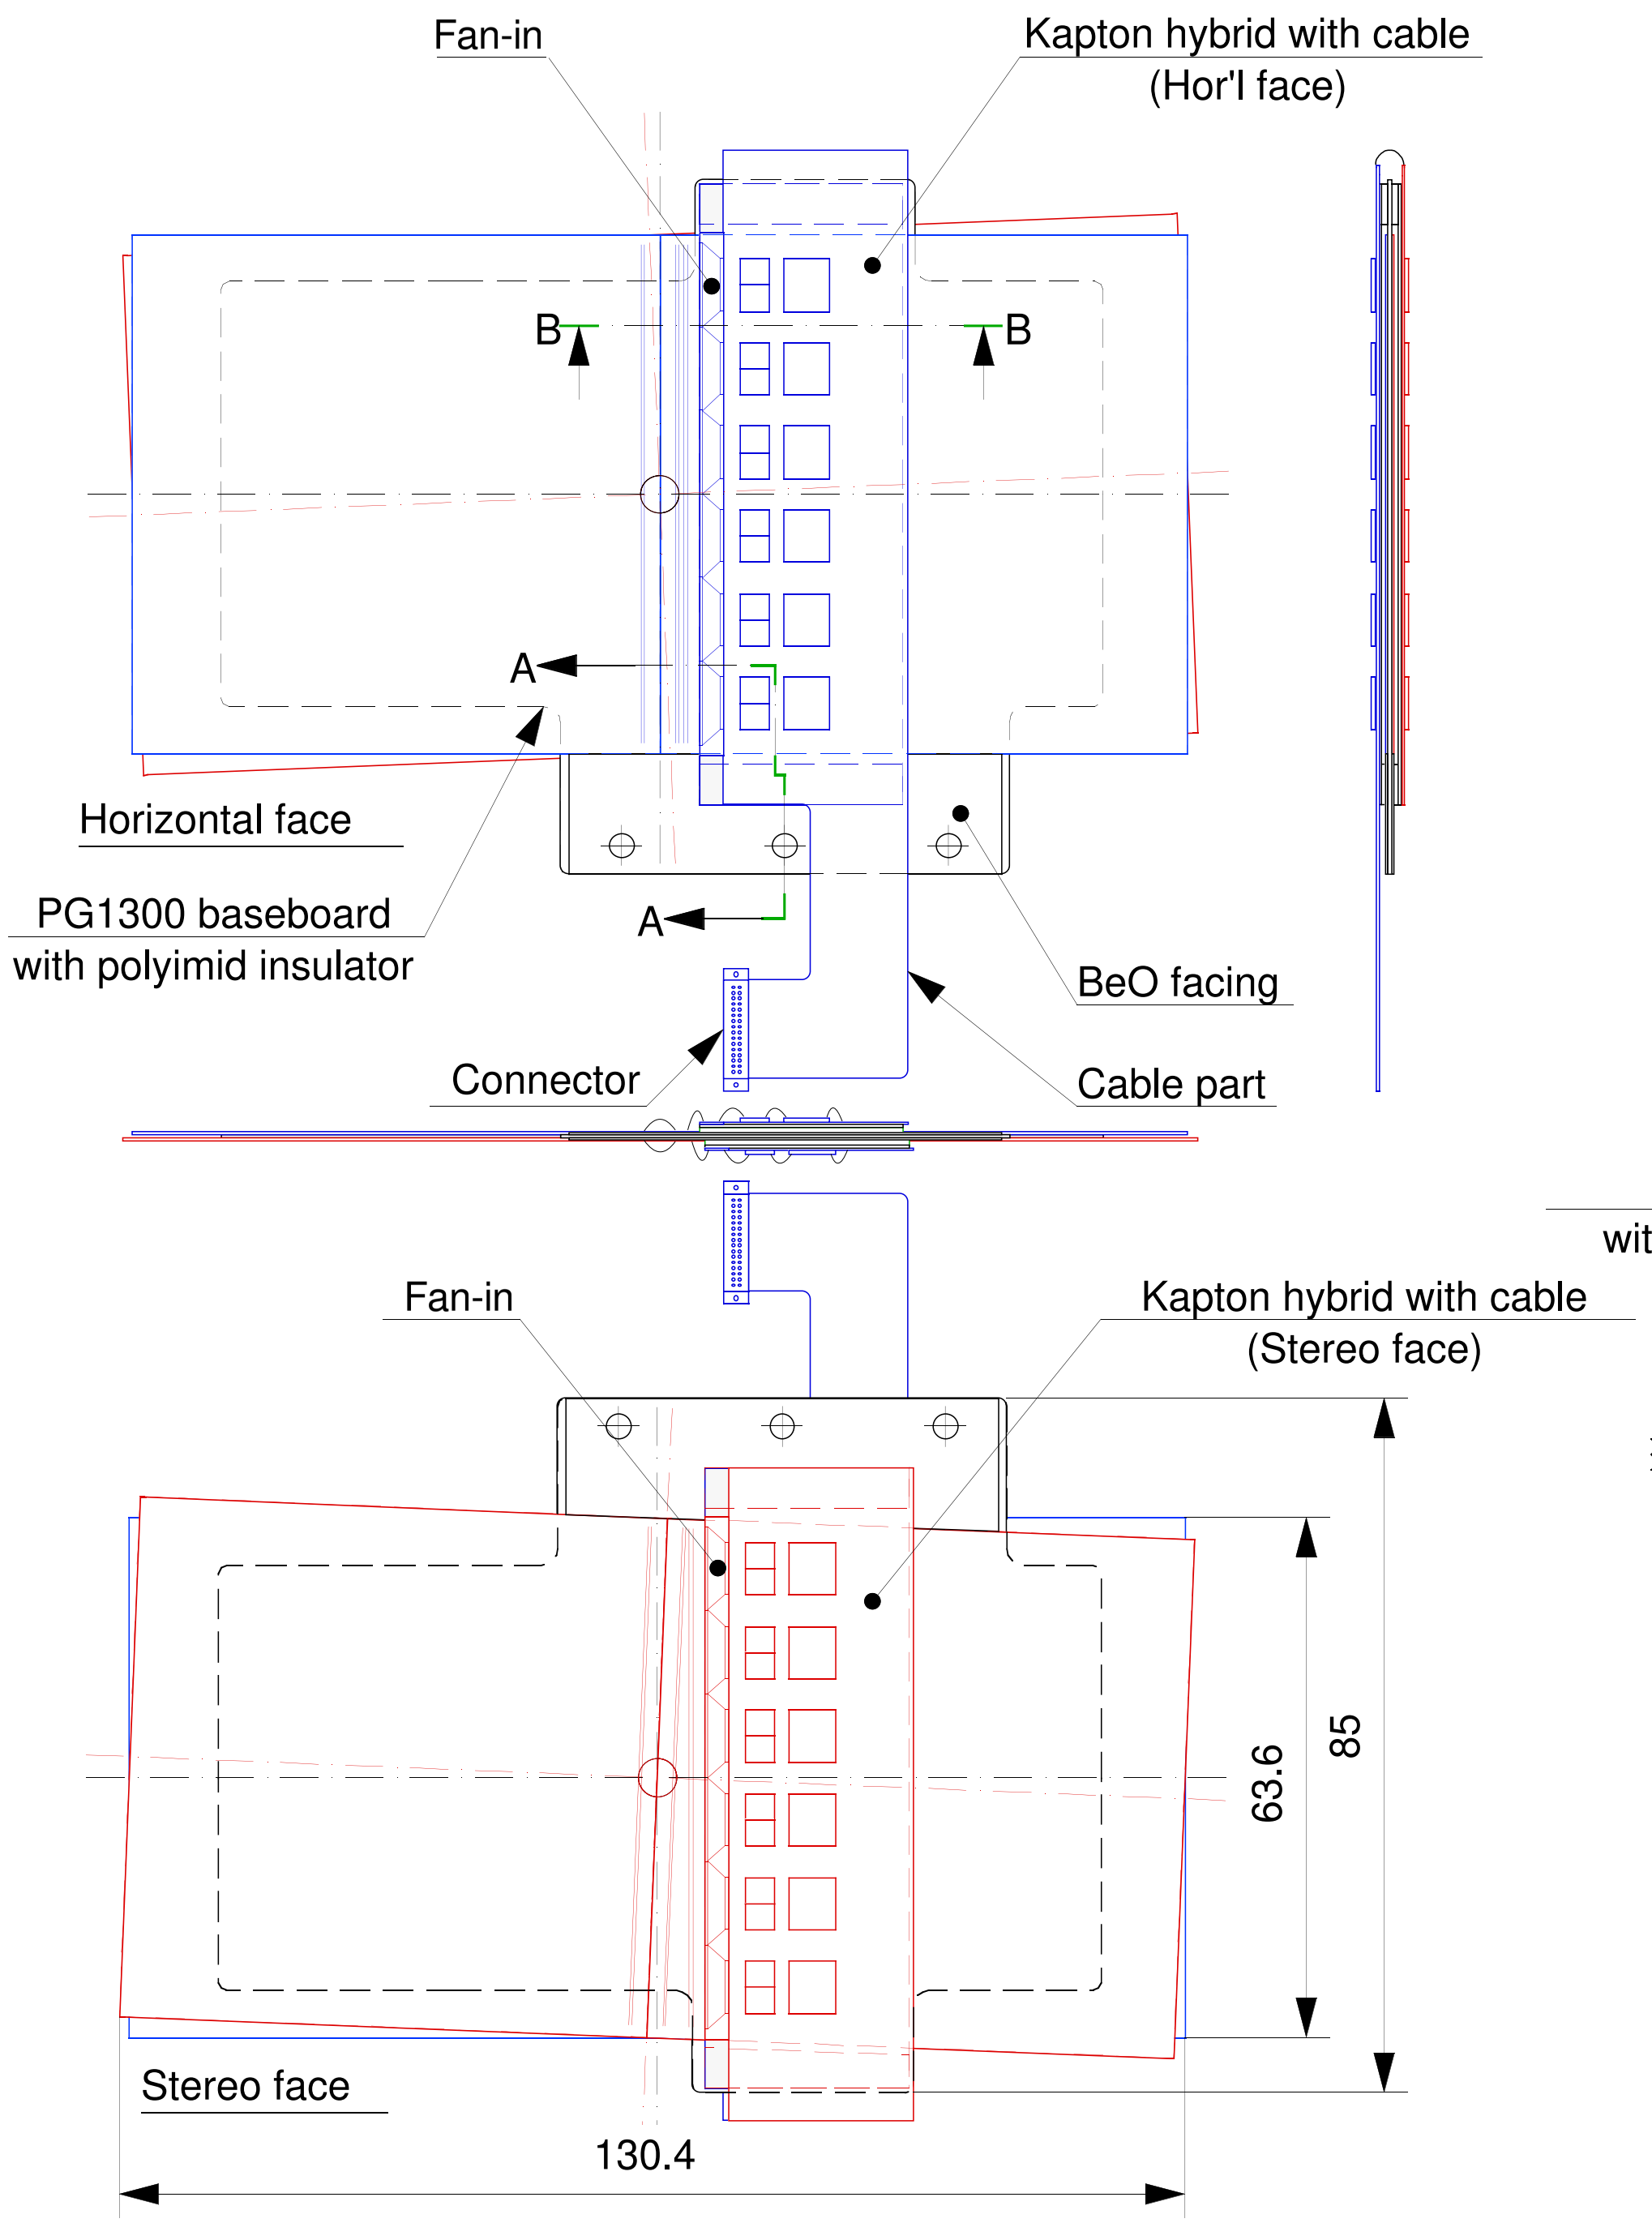

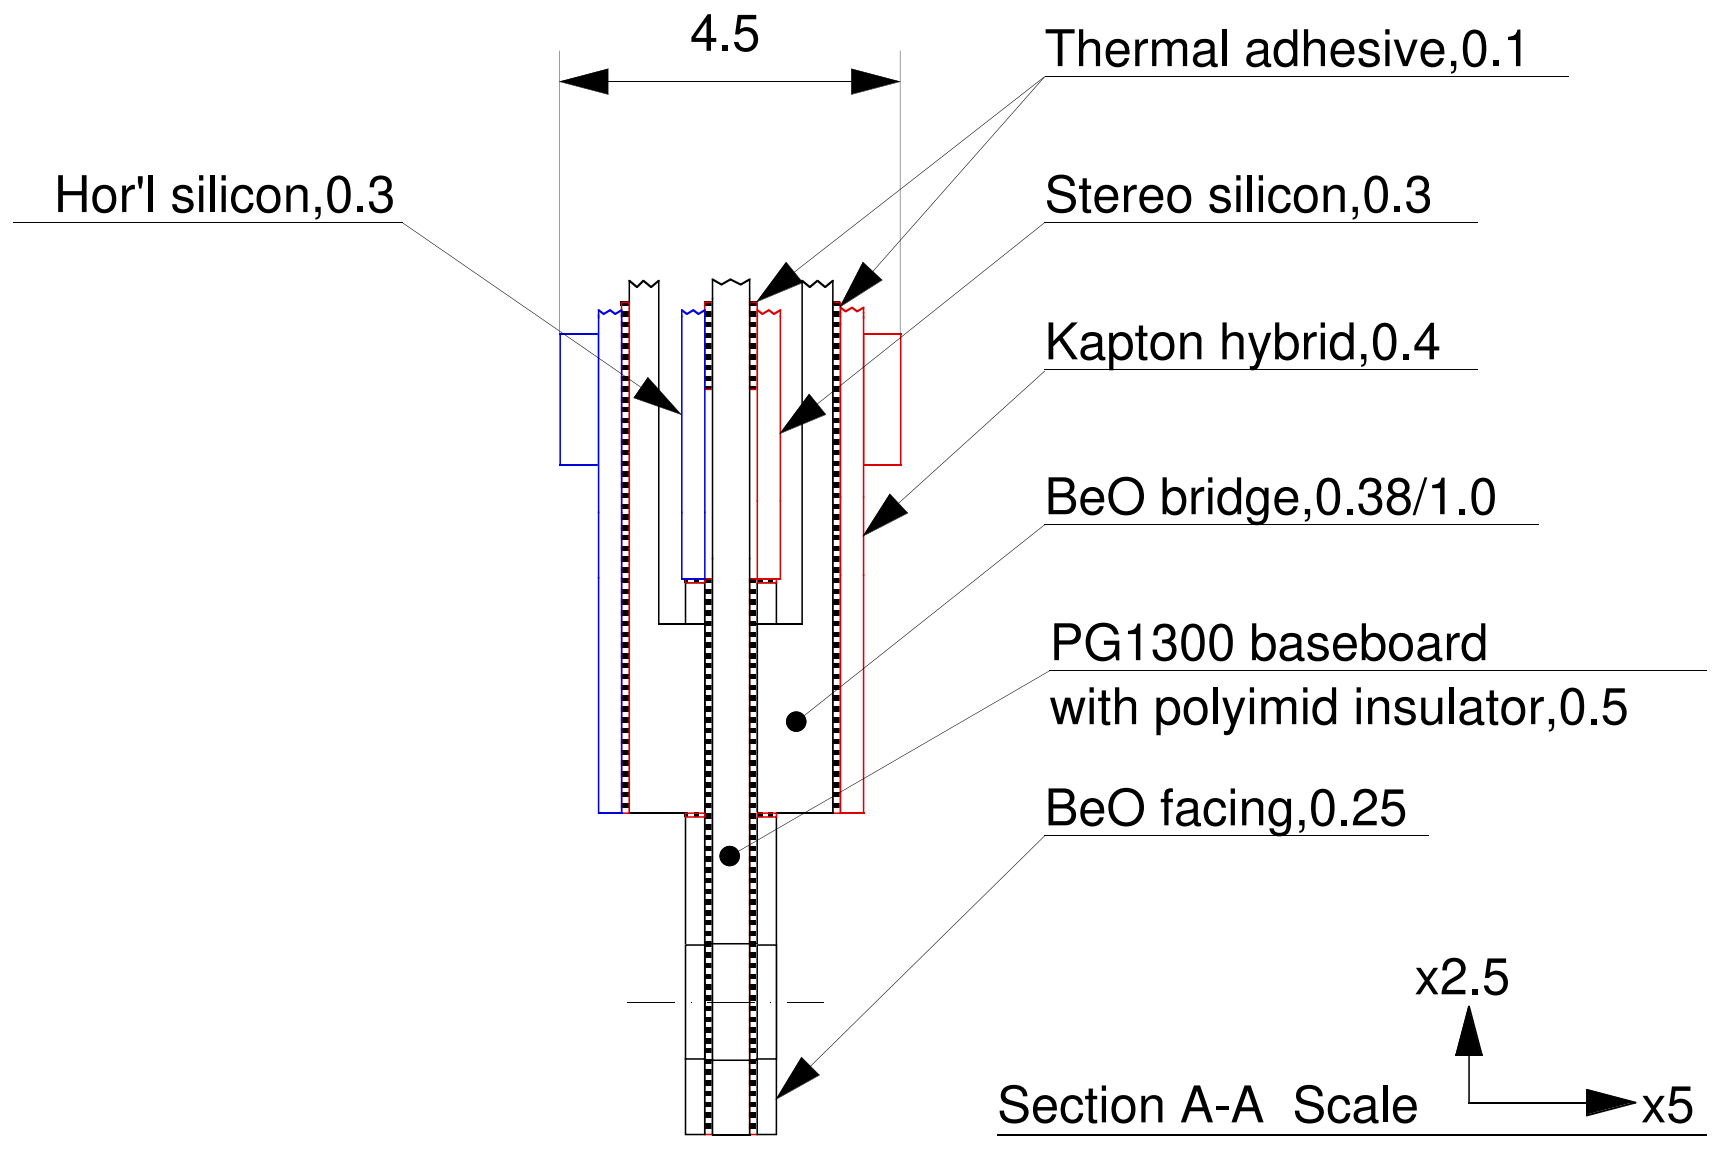

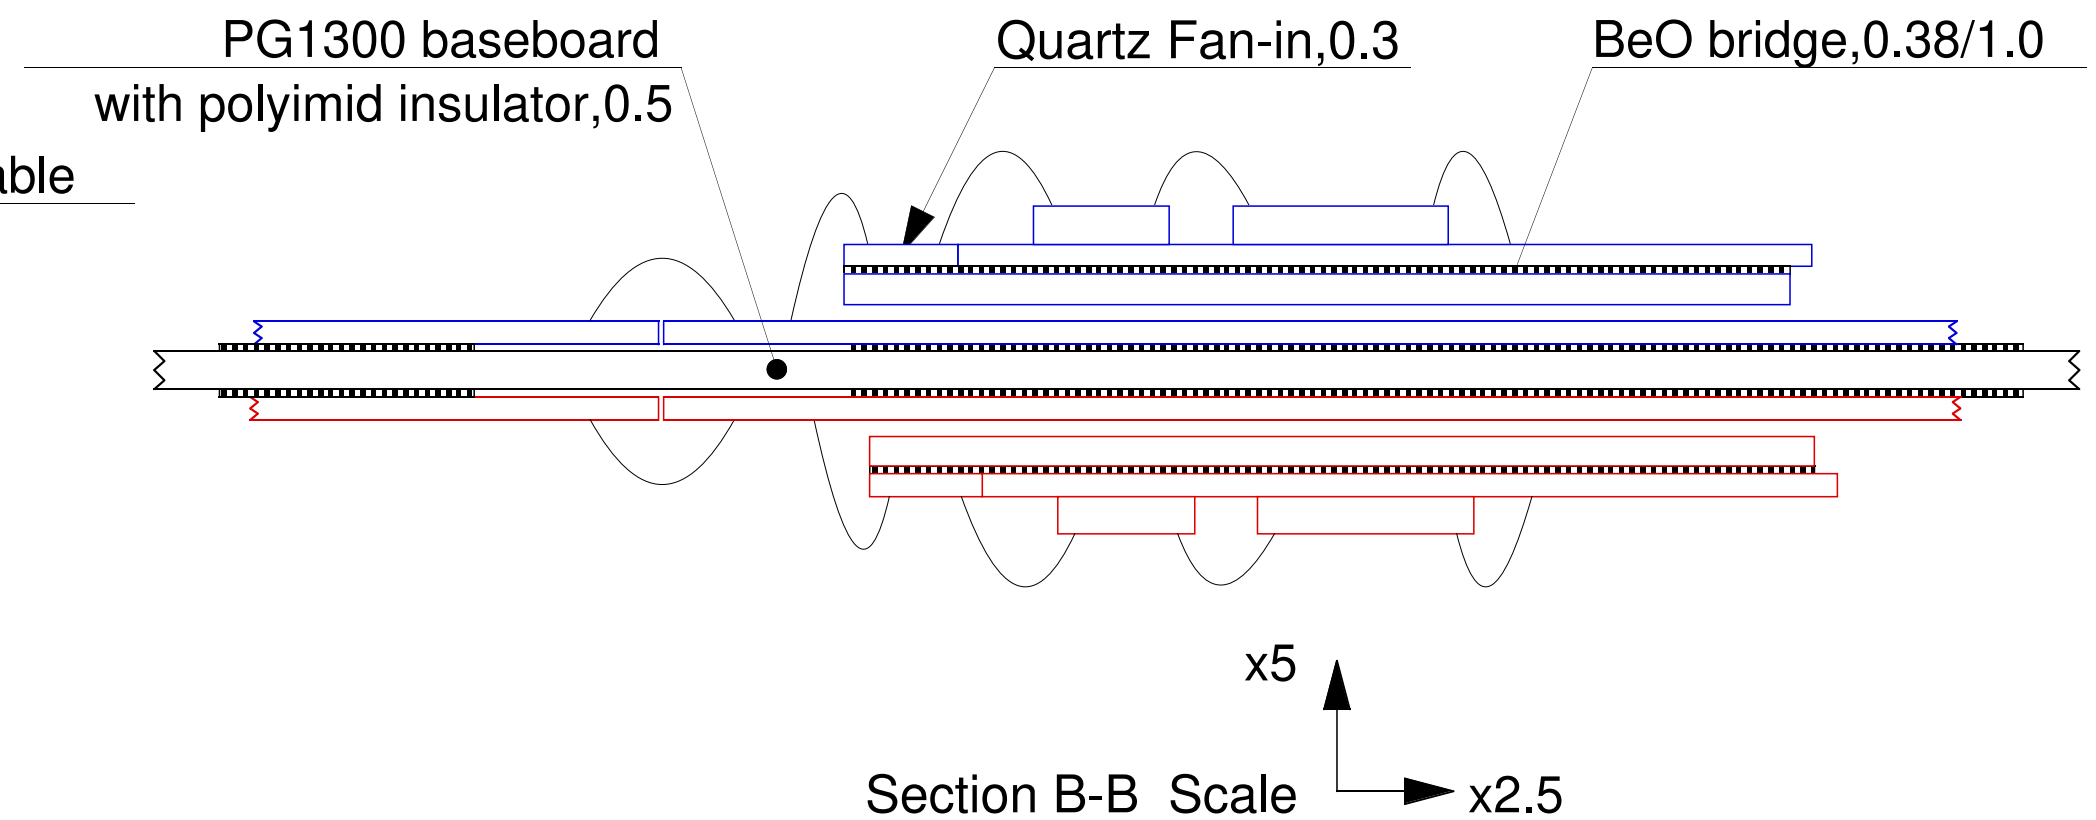

Notes:
1.Detector =0.3 x 63.6 x 64.6
2.Rotation = 40mRad.
3.Off-set = 0 mm
4.Biasing sheme-two options
1)Use PG core as a conductor
2)Separate kapton shielded cable

Scale 1/1.5

KEK centre-tap module
BeO+PG/1 cooling
December 10,1996/R2
KEK
T.Kohriki

centre&end-tap/dec96